


Switchyard One-Line Diagram

Metcalf Energy Center

Figure 5.2-1



Jackson, Michigan 3/46/99:eers consultants construction managers

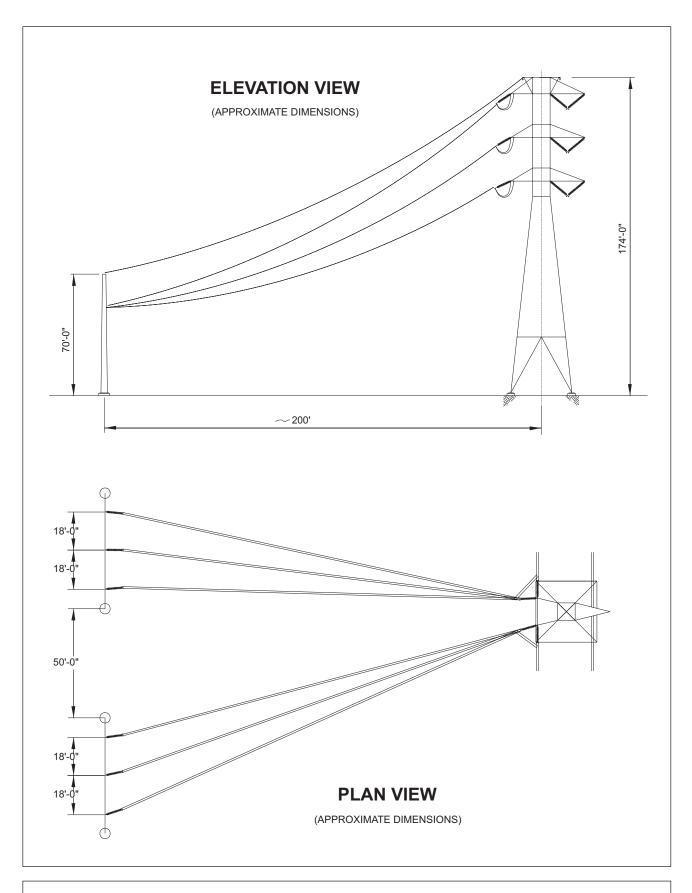




Metcalf Energy Center

Figure 5.2-3



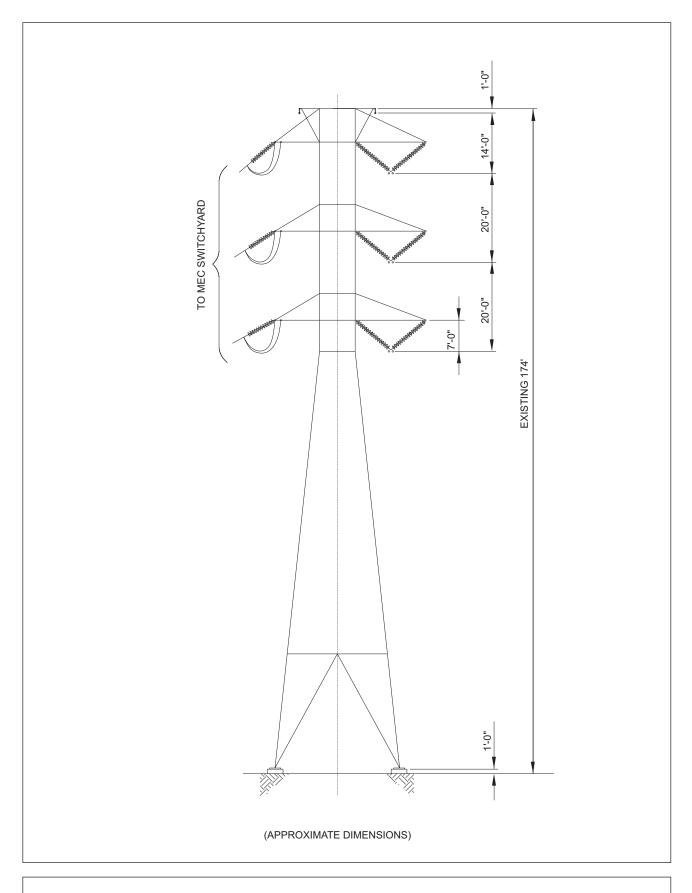


Elevation View 230 kV Typical Double Circuit Tap Structure

Figure 5.2-4




Metcalf Energy Center

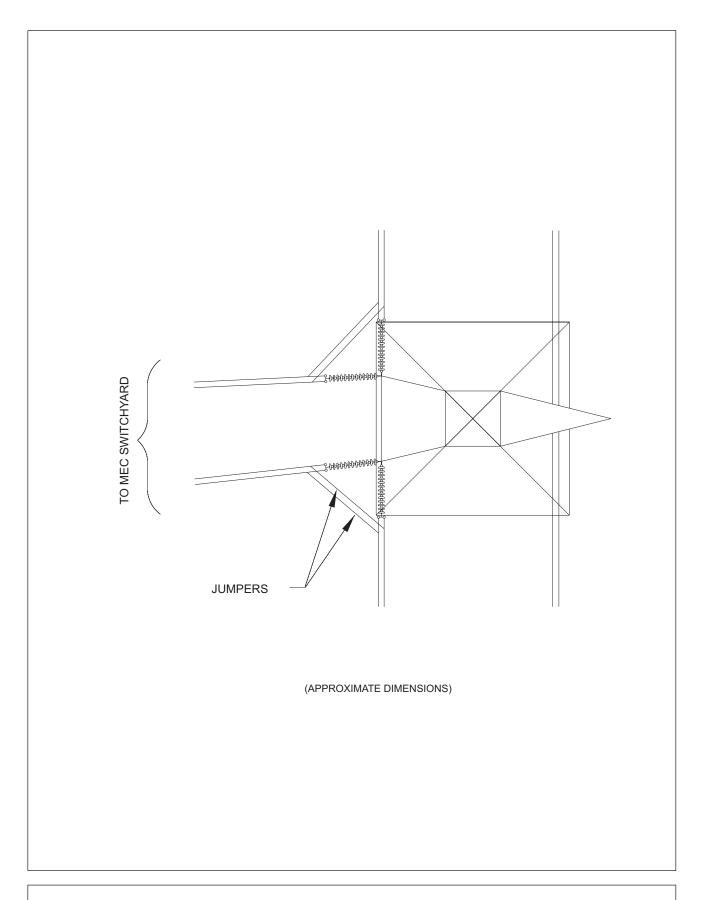

Plan View 230 kV Typical Double Circuit Tap Structure

Figure 5.2-5



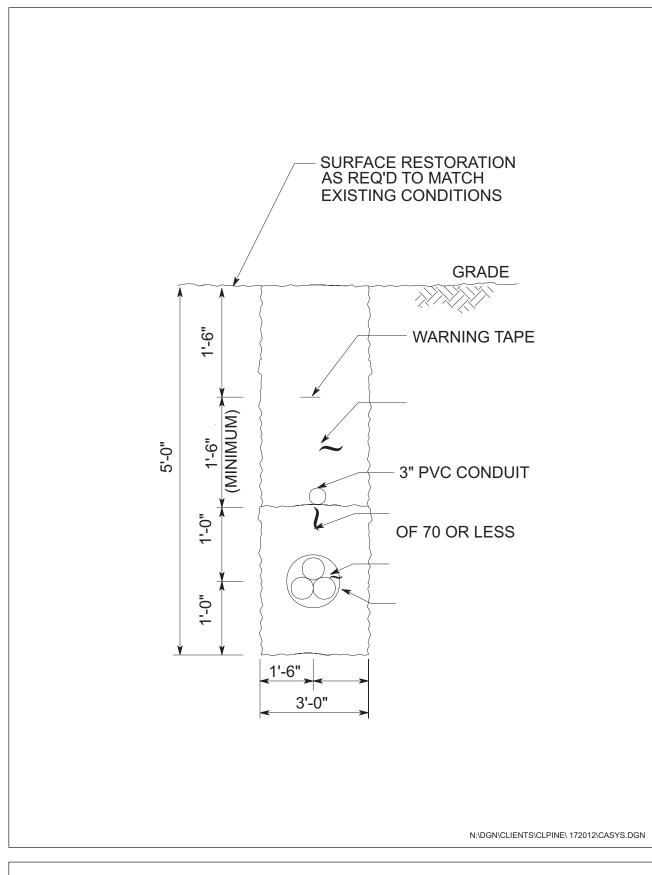

230 kV Underground Transmission Line Typical Pipe-Type Cable System

Metcalf Energy Center

Figure 5.2-6

